

RE92 *CHECKMATE*

Dual loop controller for industry purpose.



- Simple and user-friendly service
- Safety and reliability guaranteed thanks to:
 - installation category III
 - proper galvanic isolation
 - noise immunity
- Universal separated measuring inputs
- Automatic parameter selection according to the controlled object – SMART PID algorithm
- Digital communication - RS-485 (standard), Ethernet (option)
- Parameter logging on SD card

MODERN CONTROL FUNCTIONS

- independent dual loop control
- PID control, on/off, three-step control of heating-cooling, and step-by-step control
- innovative SMART PID algorithm with auto-tuning function (automatic selection of PID parameters)
- the source of control signal is one of the two inputs or the sum/difference of the signal from two inputs combined
- 4 sets of PID parameters and additional set for cooling (for each loop)
- 6 types of alarm with programmable hysteresis and memory (latch function)
- digital communication - RS-485 (standard), Ethernet (option)
- Gain Scheduling feature - automatic PID set switching, depending on the set temperature (when the object behaves decidedly differently in various temperatures)

INTUITIVE AND USER-FRIENDLY INTERFACE

- 3.5" full-colour graphic screen with luminosity control
- menu available in English
- password-protected regulator access (4 users, 3 access levels)
- signaling a state of binary inputs and two-state outputs

RELIABLE CONTROL WITH FIXED SET-POINT




- 4 set point values switchable by the binary inputs (for each loop)
- soft-start function for set point values change, programmable increase/decrease
- also an additional input may serve as the source of set point value (input 3)

ADVANCED PROGRAMMING CONTROL

- 20 internal programs (10 programs per loop)
- 15 units per program
- signaling up to 6 events per unit (two-state outputs)
- selection of PID parameters for any unit
- iterations number setting (up to 9999 repetitions)

RE92

is an advanced dual loop controller for industrial use. It was designed for demanding industrial applications. RE92 can control two controlled objects independently or control two physical values in one object (e.g. in the two-zone furnaces). Thanks to the universal measuring inputs, it can be used for controlling of temperature and other physical values (e.g. pressure, humidity). Every user can update controller's software individually, thus getting access to the additional features added by the LUMEL development team.

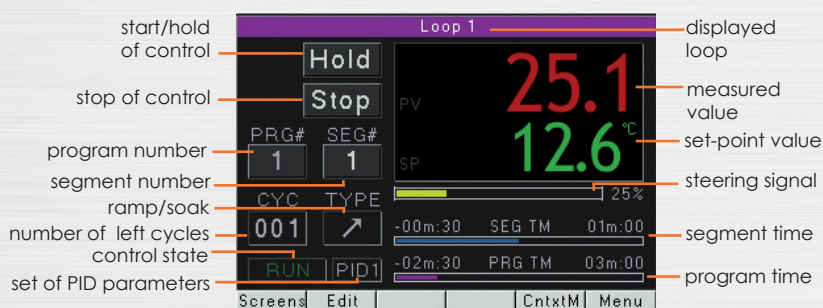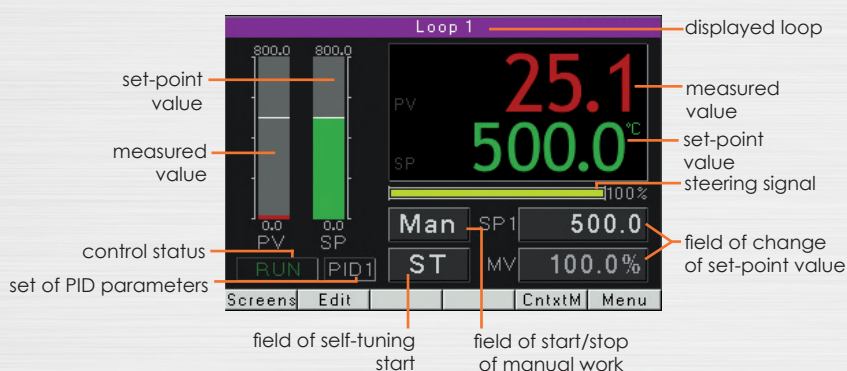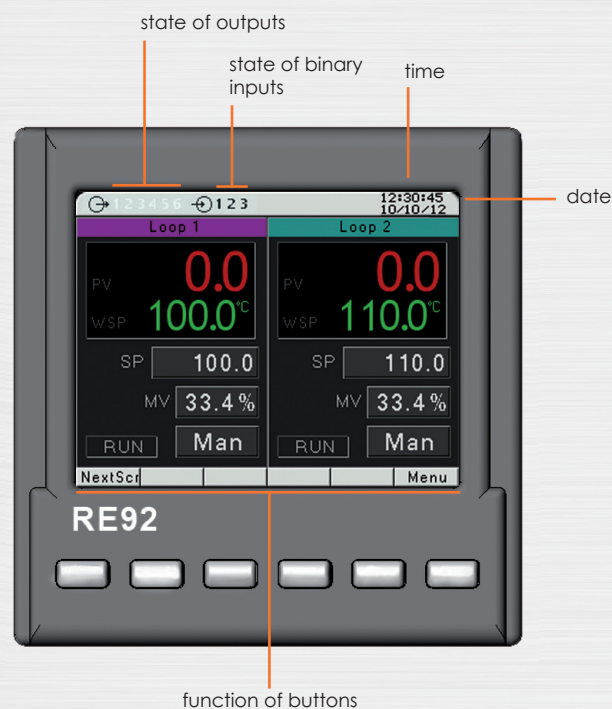

CONNECTIONS DESCRIPTION

UNIVERSAL SUPPLY

- 85...253 V a.c./d.c
- installation category III

MULTI-FUNCTIONS OUTPUTS

- 6 relay outputs or 2 binary and 4 relay outputs
- outputs features: control, alarm, signaling events and binary output state in programming control

MINI USB PORT

- designed for future uses

ETHERNET INTERFACE (OPTION)

- Modbus TCP protocol
- for the monitoring of the controller and programming
- FTP Server
(Download von Archivdateien .csv)

ADDITIONAL INPUT (OPTION)

- input 0/4...20 mA, 0...5/10 V or 0...100/1000 Ω
- programmable indication range
- averaging of the measurements with programmable time filter
- functions: measurement of controlled signal and set point value

FREE UPDATES & PARAMETER LOGGING

- software self-update using SD memory card
- process parameter logging on SD card (.csv files)

OBJECT TRANSDUCERS SUPPLY (OPTION)

- 24 V d.c., max. 30 mA
- for external transducers and sensors

UNIVERSAL INPUTS

- 2 programmable measuring inputs (temperature sensor, 0/4...20 mA i 0...5/10 V)
- programmable indication range
- averaging of the measurements with programmable time filter

RS-485 INTERFACE (SLAVE)


- Modbus RTU protocol
- for the monitoring of the regulator programming

ANALOG OUTPUTS (OPTION)


- two programmable analog output 0/4...20 mA and 0...10 V
- outputs features: control, retransmission

BINARY/LOGIC INPUTS

- 3 voltageless binary inputs
- inputs features: stop control, manual /automatic control, program control, relay outputs control

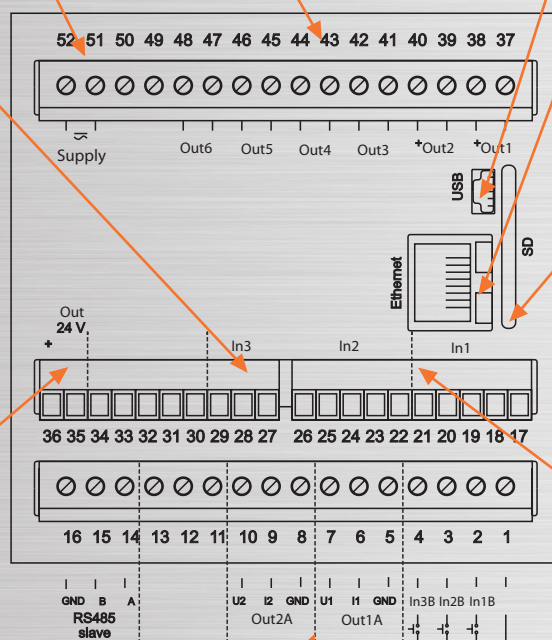

GALVANIC ISOLATION

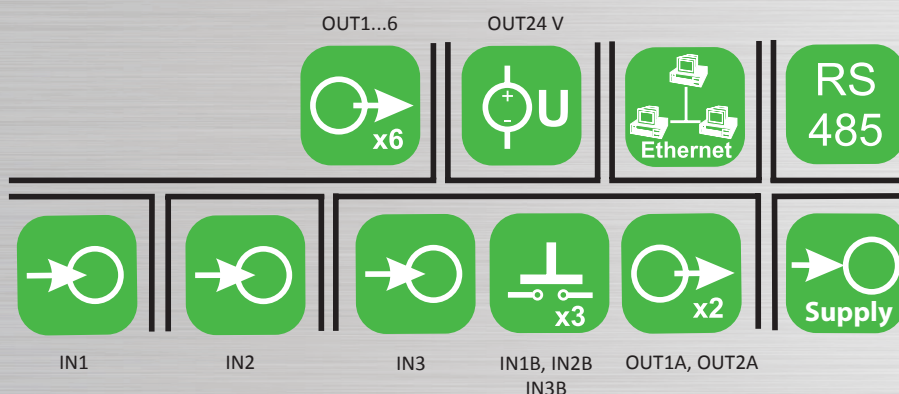

TECHNICAL DATA

INPUTS			
Input type	Range	Error	Additional error
Universal main inputs 1 and 2			
Pt100	-200 ... 850°C	0.2%	Compensation of wire resistance changes in 3-wire connection: < 0.1%
Pt500	-200 ... 850°C	0.2%	
Pt1000	-200 ... 850°C	0.2%	
Ni100/1,617	-60 ... 180°C	0.2%	Compensation of thermocouple reference cold junction: < 2°C
Cu100/1,426	-50 ... 180°C	0.2%	
Fe-CuNi (J)	-100 ... 1200°C	0.3%	
Cu-CuNi (T)	-100 ... 400°C	0.3%	Ambient temperature change: ≤ 0.1% / 10 K
NiCr-NiAl (K)	-100 ... 1372°C	0.3%	
PtRh10-Pt (S)	0 ... 1767°C	0.5%	
PtRh13-Pt (R)	0 ... 1767°C	0.5%	
PtRh30-PtRh6 (B)	0 ... 1767°C	0.5%*	
NiCr-CuNi (E)	-100 ... 1000°C	0.3%	
NiCrSi-NiSi (N)	-100 ... 1300°C	0.3%	
Current (I)	0/4 ... 20 mA	0.2% +/- 1 digit	
Voltage (U)	0 ... 5/10 V	0.2% +/- 1 digit	
Additional input			
Current (I)	0/4 ... 20 mA	0.2% +/- 1 digit	Ambient temperature change: ≤ 0.1% / 10 K
Voltage (U)	0 ... 5/10 V	0.2% +/- 1 digit	
Resistance (R)	0 ... 100/1000 Ω	0.2% +/- 1 digit	
Logic input	voltageless		

* error concerns the range: 200...1767 °C (392 ... 3212.6 °F)

OUTPUTS		
Output type	Properties	Remarks
Relay	6/4 outputs	switching contacts, 2 A/ 230 V
Voltage transistor	0/2 outputs	0/5 V ($I_{max}=20$ mA)
Continuous voltage	0...2 outputs	0...10 V, $R_{load} \geq 1$ kΩ
Continuous current	0...2 outputs	0/4...20 mA, $R_{load} \leq 500$ Ω

DIGITAL INTERFACE		
Interface type, protocol	Mode	Baud rate
RS-485, MODBUS RTU	8N2, 8E1, 8O1, 8N1	2400, 4800, 9600, 19200, 38400, 57600, 115200 bit/s
Ethernet, MODBUS TCP Slave, FTP server		

EXTERNAL FEATURES		
Readout field	colorful display TFT 3,5"	320 x 240 pixels
Overall dimensions	external: 96 x 96 x 100 mm	panel cut-out: 92.5 x 92.5 mm
Weight	< 0.5 kg	
Protection grade	from the frontal side: IP65	from the terminal side: IP20

RATED OPERATING CONDITIONS		
Supply voltage	85...253 V a.c./d.c.	frequency: 40...50...440 Hz
Temperature	ambient: 0...23...50°C	storage: -20...70°C
Humidity	< 85%	without condensation
Operating position	any	


SAFETY AND COMPATIBILITY REQUIREMENTS		
Electromagnetic compatibility	noise immunity	acc. to EN 61000-6-2
	noise emissions	acc. to EN 61000-6-4
Pollution level	2	
Installation category	III	
Maximal phase-to-earth operating voltage	for supply circuit, relay outputs: 300 V	for input circuits, interface, continuous and voltage 0/5 V outputs: 50 V
Altitude above sea level	up to 2000 m	

SOFTWARE

For easy programming and devices configuration LUMEL offers one common eCon software. It is developed with expansion of the products offer.

eCON - FREE CONFIGURATION TOOL

- program for remote service of RE92 configuration (by RS-485 interface)
- user-friendly saving of the configuration to file and fast copying the settings to other RE92s
- the most current version is always available on www.lumel.com.pl

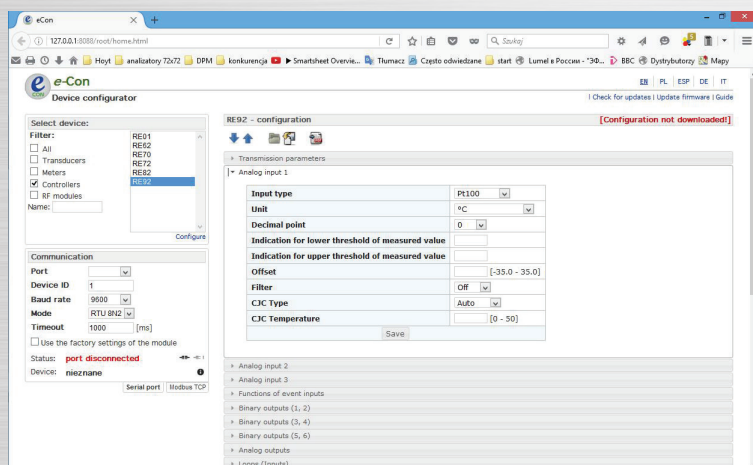

PARAMETER LOGGING

- archiving on the SD card (three independent groups of data archiving of 10 values in the group)
- archival data are available in the CSV files
- archival data could be downloaded directly from SD card or via FTP server (available only with Ethernet functionality)




12010001	106100919.CSV	121 KB	Microsoft Excel Com...	2015-06-10 09:56
2015	106100956.CSV	19 KB	Microsoft Excel Com...	2015-06-10 10:03
06	106101003.CSV	5 KB	Microsoft Excel Com...	2015-06-10 10:04
1	106101004.CSV	48 KB	Microsoft Excel Com...	2015-06-10 10:18
2	106101018.CSV	54 KB	Microsoft Excel Com...	2015-06-10 10:38
3	106101038.CSV	177 KB	Microsoft Excel Com...	2015-06-10 11:31
	106101131.CSV	70 KB	Microsoft Excel Com...	2015-06-10 11:55

date, time, record index, block, register1, name1, value1	...	register10, name10, value10
2015-05-28, 13:56:47, 0000016179, 1, 7000, PV_IN1, 1.229140E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:52, 0000016179, 1, 7000, PV_IN1, 1.228914E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:57, 0000016180, 1, 7000, PV_IN1, 1.229120E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:02, 0000016181, 1, 7000, PV_IN1, 1.229202E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:07, 0000016182, 1, 7000, PV_IN1, 1.229140E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:15, 0000016183, 1, 7000, PV_IN1, 1.229133E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:17, 0000016184, 1, 7000, PV_IN1, 1.229140E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:22, 0000016185, 1, 7000, PV_IN1, 1.229762E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:27, 0000016186, 1, 7000, PV_IN1, 1.229571E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:32, 0000016187, 1, 7000, PV_IN1, 1.229061E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:37, 0000016188, 1, 7000, PV_IN1, 1.229109E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:42, 0000016189, 1, 7000, PV_IN1, 1.229386E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:47, 0000016190, 1, 7000, PV_IN1, 1.229141E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:56:52, 0000016191, 1, 7000, PV_IN1, 1.229140E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:56:57, 0000016192, 1, 7000, PV_IN1, 1.228967E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:57:02, 0000016193, 1, 7000, PV_IN1, 1.229227E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:57:07, 0000016194, 1, 7000, PV_IN1, 1.228925E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:57:12, 0000016195, 1, 7000, PV_IN1, 1.229140E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:57:17, 0000016196, 1, 7000, PV_IN1, 1.229225E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:57:22, 0000016197, 1, 7000, PV_IN1, 1.229153E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:57:27, 0000016198, 1, 7000, PV_IN1, 1.229140E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:57:32, 0000016199, 1, 7000, PV_IN1, 1.229390E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:57:37, 0000016200, 1, 7000, PV_IN1, 1.229175E+02	...	7005, PV_IN5, 1.000000E+20
2015-05-28, 13:57:42, 0000016201, 1, 7000, PV_IN1, 1.229204E+02	...	7002, PV_IN2, 1.000000E+20
2015-05-28, 13:57:47, 0000016202, 1, 7000, PV_IN1, 1.229224E+02	...	7005, PV_IN5, 1.000000E+20

EXAMPLE OF APPLICATION

Temperature control in two-section furnace.

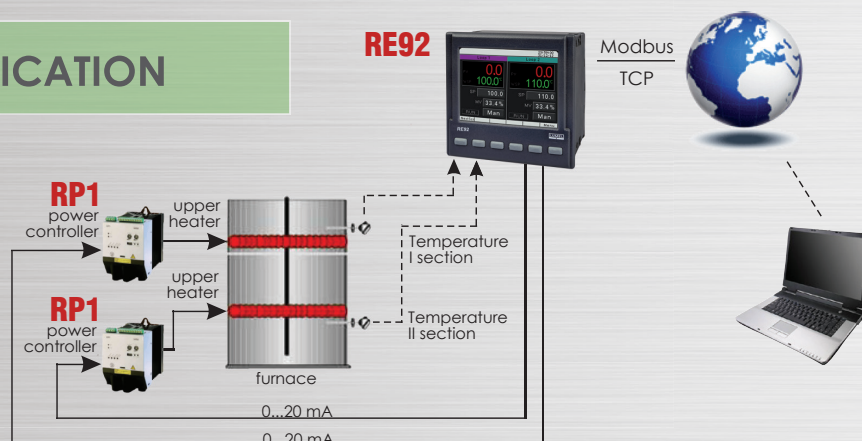

ORDERING CODE

	RE92 -	X	X	X	X	X	XX	X	X
Input 3:									
none	0								
current: 0/4...20 mA	1								
voltage: 0...10 V	2								
potentiometric transmitter: 1000 Ω	3								
Output 1 and 2:									
2 relays	1								
2 binary outputs 0/5 V	2								
Analog outputs:									
none	0								
2 continuous 0/4...20 mA and 0...10 V	1								
Ethernet:									
none	0								
with Ethernet	1								
Transducer supply:									
none	0								
24 V d.c. 1 W	1								
Version:									
standard	00								
custom-made ¹⁾	XX								
Language:									
Polish	P								
English	E								
other ²⁾	X								
Additional quality requirements:									
without additional quality requirements	0								
with an extra inspection quality certificate	1								
acc. to customer's request ²⁾	X								

IN STANDARD VERSION

(RE92-0-1-0-0-0-00-E-0):

2 universal inputs
3 binary inputs
6 relay outputs
RS-485 Modbus Slave
supply 85...253 V a.c./d.c

¹⁾ - the code will be established by the manufacturer

²⁾ - after agreeing with the manufacturer

Order example:

The code **RE92 -1-10-1-0-00-E-0** means: controller RE92, with additional input: current 0/4...20 mA, output 1 and 2: 2 relays, analog outputs: none, with Ethernet, transducer supply: none, standard version, English language, without additional quality requirements.

SEE OTHER CONTROLLERS WITH SMART PID ALGORITHM:

BASIC



RE71

RE81

ADVANCED



RE72

RE82

LUMEL
EVERYTHING COUNTS

LUMEL S.A.

ul. Sulechowska 1, 65-022 Zielona Góra, POLAND
tel.: +48 68 45 75 100
www.lumel.com.pl

Export Department:

tel.: (+48 68) 45 75 302, 45 75 233, 45 75 305, 45 75 321
fax: (+48 68) 32 54 091
e-mail: export@lumel.com.pl